

Nitric Oxide (NO) Gas Detection and Control System



**PolyGard
SPC2-1129**

DESCRIPTION

Gas monitor with built-in nitric oxide (NO) sensor, wall-mounted, accepts inputs from remote devices such as other gas sensors, temperature or humidity sensors.

APPLICATION

To detect and control levels of nitric oxide (NO) and other gases in a wide variety of commercial and industrial applications such as manufacturing equipment rooms, machine and engine repair shops, and ventilation systems, etc. The controller can interface via binary outputs and up to (2) 4-20 mA signals with any compatible electronic analog control, DDC/PLC control or automation system.



FEATURES

- *Continuous monitoring*
- *One (1) built-in NO electrochemical sensor, gas specific, long life*
- *Easy plug-in sensor*
- *Three (3) remote analog inputs, 4-20 mA*
- *Five (5) relay outputs:*
 - *Five-stage control*
 - *Fail-safe assignable*
- *Two (2) analog outputs, 4-20 mA*
 - *Selectable for low, high or averaging*
- *Liquid Crystal Display (LCD)*
- *LED status indicators*
- *Accepts combination of toxic or combustible gases, refrigerants, temperature or humidity remote sensor inputs*
- *Built-in horn*
- *Keypad user interface*
- *Simple menu-driven programming*
- *RFI/EMI protected*
- *Modular technology*
- *Overload & short-circuit protected*
- *NEMA 4X enclosure*
- *Easy maintenance*



NRTL Certification to STD
UL 61010-1
"Pending"

SPECIFICATIONS

Electric		Type of Control	
Power supply	24 VAC/VDC, -15%/+20%, 50/60 Hz, auto-resettable fuse	General	Five-stage (S1 to S5) control, assignable up to five (5) binary/relay output, i.e.
Power consumption	13 VA (0.5 A), w/max sensor connections		Low-med-high-fault/fail-horn*, or low1-low2-med1-med2-high, or any other combinations
RF/EMI protected	4.0 W @ 3 ft. (1 m) radiated		(* = horn/audible alarm built-in and factory pre-configured to relay output "R05")
Sensor Performance		Analog inputs	Three (3) 4-20 mA, for additional remote sensors
Gas detected	Nitric oxide (NO)	Analog reading	Current and mean (average) value
Sensor element	Electrochemical, diffusion	Stage level / setpoint	Field adjustable over full range, five (5) per analog input, assignable to current or mean (average) value
Range	Span field selectable from 0-50 to 0-100 ppm via calibration, 0-50 ppm factory set		
Stability & resolution	± 0.5 ppm of reading		
Repeatability	± 2% of reading		
Long term output drift	< 2% signal loss/month		
Response time	t ₉₀ < 25 sec.		
Sensor life expectancy	3 years, normal operating environment		
Sensor coverage	4,000 sq.ft., max. 6,000 sq.ft. (372 m ² , max. 558 m ²), under "ideal conditions"	- hysteresis/ switching differential	Selectable for each sensor point
Installation Location		Digital inputs	Four (4), each can be individually assigned to any relay (R1...R5). Digital inputs are used for remote audio/visual alarm reset
Mounting height	1 to 3 ft (0.3 to 1.0 m) below ceiling		

SPECIFICATION

Type of Control (Cont...)

Relay outputs (R1-R5) w/ status LEDs	Five (5) SPDT, 8A 24 VAC/VDC-250 VAC contact resistance 100 mΩ, max.
- each stage level (S1-S5)	Assignable to any relay
- sensor fail-safe	Assignable to any stage level
Time delay switching	Selectable for make and brake of each sensor point (SP1 to SP4) 0-9,999 seconds
Analog output	Two (2) independent 4-20 mA signal, 500 Ω max. load, selectable as low, high or averaging of sensor inputs
Audible alarm	90 db, enabled or disabled, selectable; assignable to stage level S1, S2, S3, S4 or S5
Alarm acknowledgement	Menu-driven and system reset function for latched relays

User Interface

Keypad type	Refer to "illustration keypad user interface"
Touch buttons	Six (6)
Status LED's	Yellow: Fault (fail) Red: Alarm
Digital display	Liquid Crystal Display (LCD), two lines, 16 characters per line, 1 digit resolution, backlit
- unit display	Menu selectable, per sensor; ppm, %v/v, %LEL, °F or % RH

Environmental

Permissible ambient	
- working temperature	23°F to 122°F (-5°C to 50°C)
- storage temperature	23°F to 86°F (-5°C to 30°C)
- humidity	15 to 95% RH, non-condensing
- working pressure	Atmospheric ± 10%

Physical


Enclosure (panel)	
- material	Polycarbonate, impact resistance EN 50102/IK08, flammability rating UL 94-5V
- conformity	UL Type 1, UL 508/UL 50 standards
- color	Light gray, smoked gray for cover
- protection	NEMA 4X (IP 65)
- installation	Wall (surface) mounted
Dimensions (H x W x D)	
- base	7.9 x 7.5 x 4.1 in. (200 x 190 x 105 mm)
Cable entry	5 holes for 1/2 in. conduit, covered
Wire connection	Terminal blocks, Push-on connect and screw type for lead wire
Wire size	
- input	Min. 22 AWG (0.34 mm ²) Max. 16 AWG (1.50 mm ²)
- output	Min. 24 AWG (0.25 mm ²) Max. 14 AWG (2.50 mm ²)
Weight	4.5 lbs. (2.0 kg)

Approvals / Listings

- unit rating	NRTL Certification to STD ANSI/UL 61010-1 – "Pending" CE EMV-Compliance 89/336/EWG
- relays (R1-R5)	UL Recognized, E5610 & E108658 CSA, C22.2 No. 14, LR35579 VDE
- enclosure (panel)	UL Listed, E75645
Warranty	Two years material and workmanship

ORDERING INFORMATION

SPC2-1129 - 0 00 US

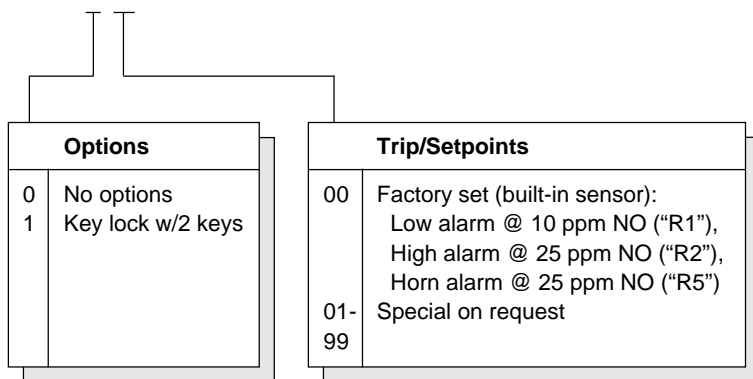

Standard control system, ordering part number:


SPC2 - 1129 - 000 US,
configuration includes:

Digital, programmable controller with menu-driven keypad user interface, LCD & LEDs, 24 VAC/VDC, 50/60 Hz NEMA 4X enclosure

- Built-in: (1) NO sensor/transmitter
(1) Horn, audible alarm
- Inputs: (3) 4-20 mA, for remote sensors
(4) Digital
- Outputs: (5) Relays, SPDT, 8 A
(2) 4-20 mA


USER INTERFACE & CONTROLLER

Keypad User Interface

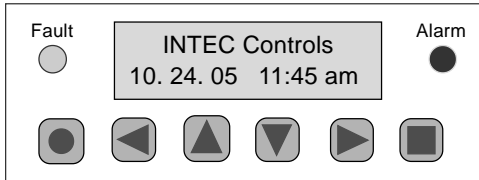

- Fault** "Yellow LED" Flashes at system / sensor failed
- Alarm** "Red LED" Flashes when any stage level setpoint is exceeded; steady when any relay output is in manual override operation
- Scroll down & up in Main menu and Sub menus; increases or decreases a value
- Navigates through menus on the same level; moves cursor when inputting data
- Exits programming and saves settings or return to previous level or menu
- Enter Sub menus or stores data; horn silence (if assigned)

Main Page & Main Menu

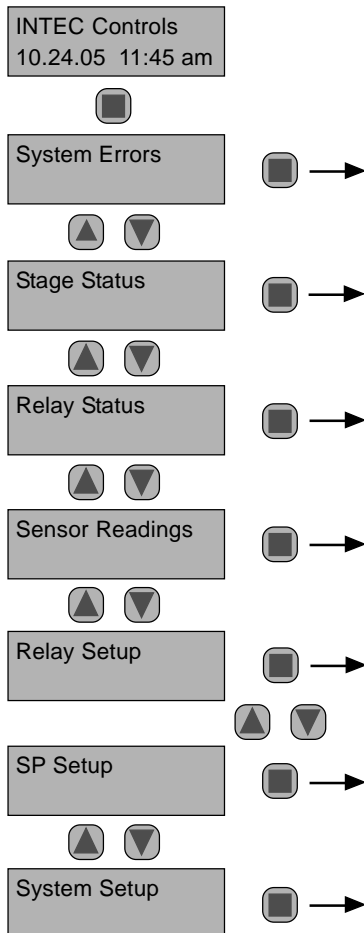

System Operation

All Programming is made via the keypad user interface in combination with the display screen. Security is provided via two password levels. The lower level password allows to override or to reset system status functions. The upper level password allows all programming and override functions.

Main Page Display

Displays date and time, unless a system error occurs, then the error is displayed.

Main Menu

Displays headings of "System Errors", "Stage Status", "Relay Status", "Sensor Readings", "Relay Setup", "SP (Sensor Point) Setup", and "System Setup".

Sub Menu "System Errors"

Displays errors, reset corrected errors, and historical error summary.

Sub Menu "Stage Status"

Displays status of each "SP" sensor point, stage level/setpoint exceeded.

Sub Menu "Relay Status"

Displays status and manual control of each output relay.

Sub Menu "Sensor Readings"

The current and mean/average values are displayed for each "SP" sensor point with sensing type and engineering unit (ppm, %v/v, %LEL, F, %RH).

Sub Menu "Relay Setup"

Enter and /or change parameters of each relay.

- Assign de-energized or energized normal operation
- Select steady or flashing function
- Select horn function
- Select latching or non-latching mode
- Select digital input usage, and assign to any output relay

Sub Menu "SP Setup"

Enter and/or change parameters of each sensor point.


- Activate sensor point
- Select sensor point type (gas, temperature, humidity)
- Select measuring range
- Select sensor signal
- Select stage/setpoint 1 to 5
- Select hysteresis
- Set delay ON/OFF time
- Select current or mean/average value
- Assign sensor point fault to stage level setpoint
- Assign setpoint 1 to 5 to any output relay
- Assign to analog Output

Sub Menu "System Setup"

Enter and/or change system parameters.

- Select service mode
- Set next maintenance date
- Select service phone number
- Select averaging function, time and overlay, of any SP
- Set date, time and time format
- Change customer password
- Select analog output function
- Set failure relay
- Select power ON time
- Select appropriate hardware configuration

FIELD WIRING CONFIGURATION

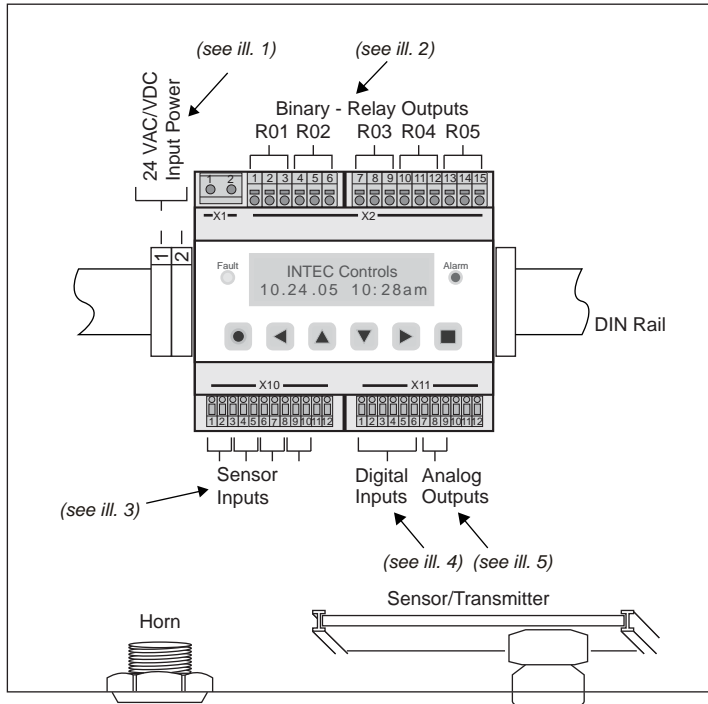

Recommended

- **Twisted, shielded wire for analog inputs**
(Shield to be terminated and connected only at the sensor/transmitter location)
- **Grounded housing**


Caution:

The non-metallic enclosure does not provide grounding between conduit connections. Use grounding bushings and jumper wires.

The enclosure is to be mounted using the mounting holes located in the base external to the equipment cavity, or the equivalent.

The conduit hubs must be connected to the conduit before connected to the enclosure.


When connecting conduit to the enclosure use only UL listed or UL recognized conduit hubs that have the same environmental type rating as the SPC2 enclosure.

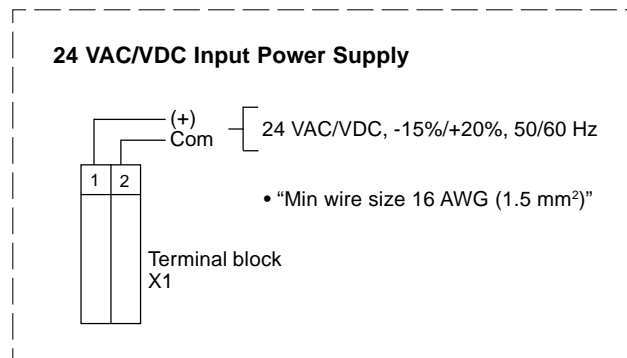

ill. 1


FIELD WIRING CONFIGURATION (cont...)

Binary - Relay Outputs “R01 to R05”

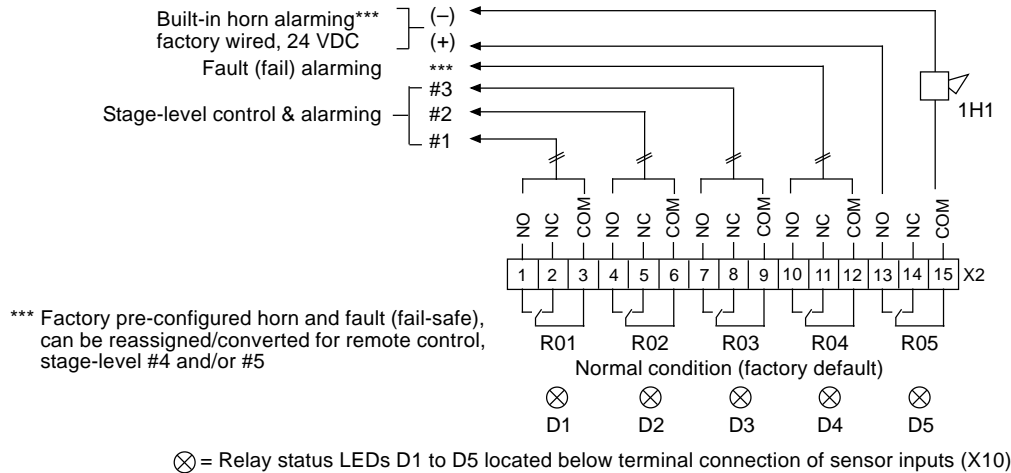


ill. 2

Digital Inputs “DI01 to DI04”



ill. 4

Analog Outputs “AO01 and AO02”




4-20 mA signal to remote control or BAS, selectable low, high or averaging of (4) analog (sensor) inputs, 500 Ω max. load

The current signal is sourced by the SPC2 system

ill. 5

Remote Sensor Inputs “SP02 to SP04”

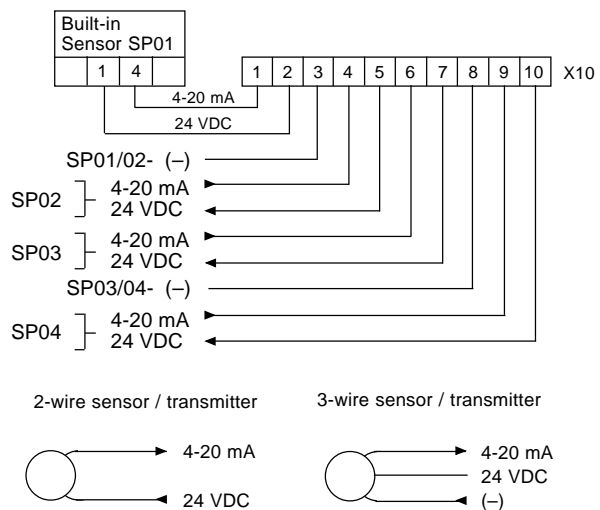

ill. 3